


### NOTES:

1. VALVES 4" AND LARGER SHALL BE INSTALLED IN A MANHOLE.
2. VALVES SMALLER THAN 4" SHALL BE INSTALLED IN A VALVE BOX.
3. ALL JOINTS SHALL BE RESTRAINED.  
(MEGALUG OR EQUAL)

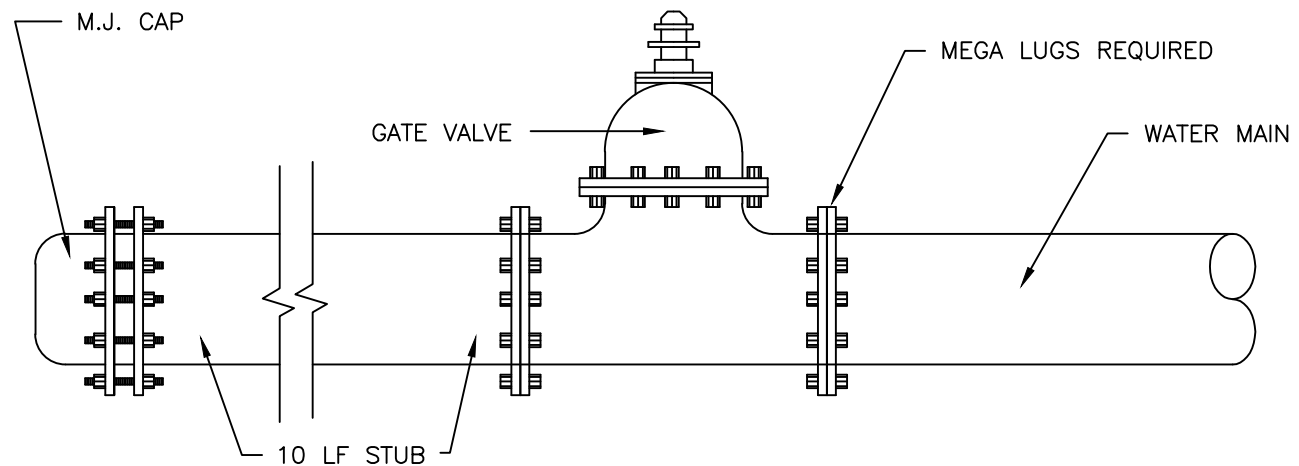

NOTE: SEE DETAIL W32 FOR RESTRAINT REQUIREMENTS UPSTREAM OF THE VALVE

## TYPICAL LINE STUB

STANDARD  
CONSTRUCTION  
DETAILS